


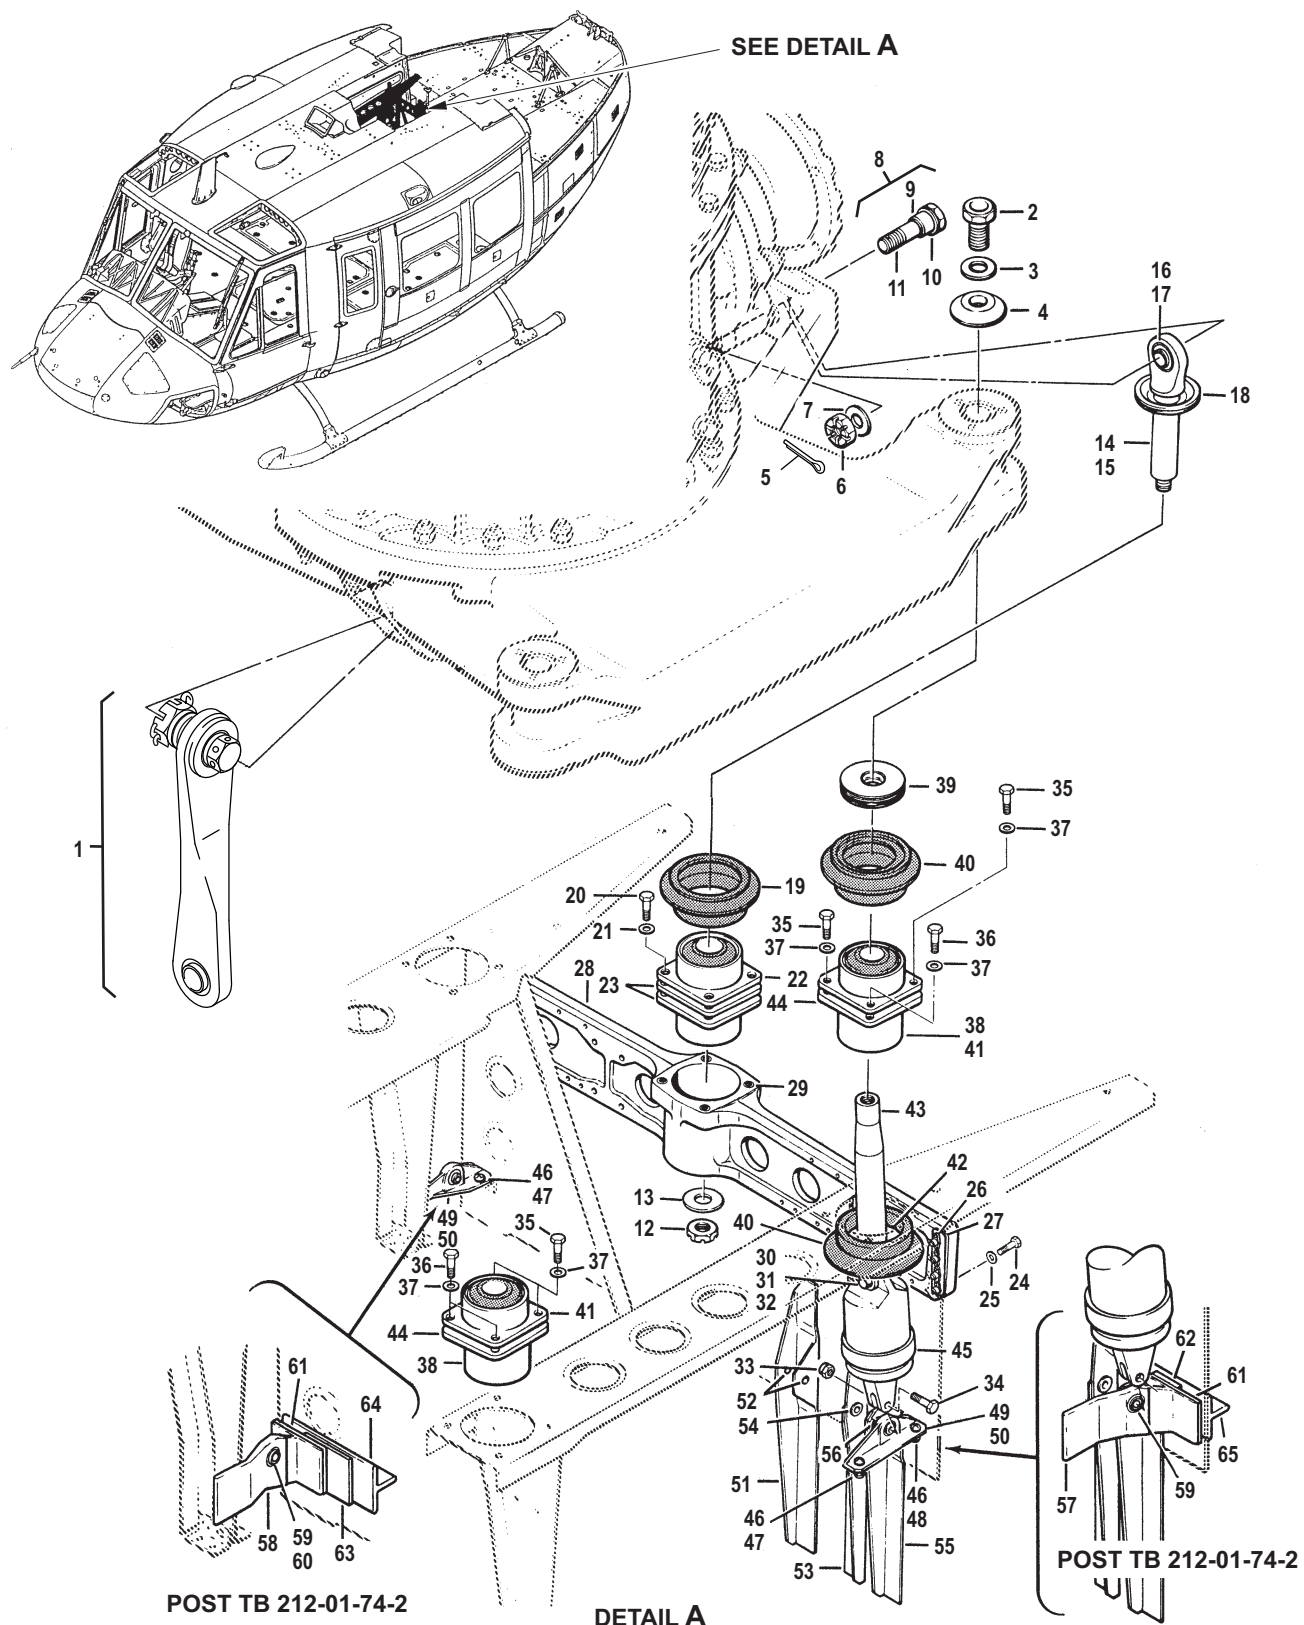

212_IPB_63_0025_c01

Figure 63-25. Pylon Support Installation